


How to Water circuit installation

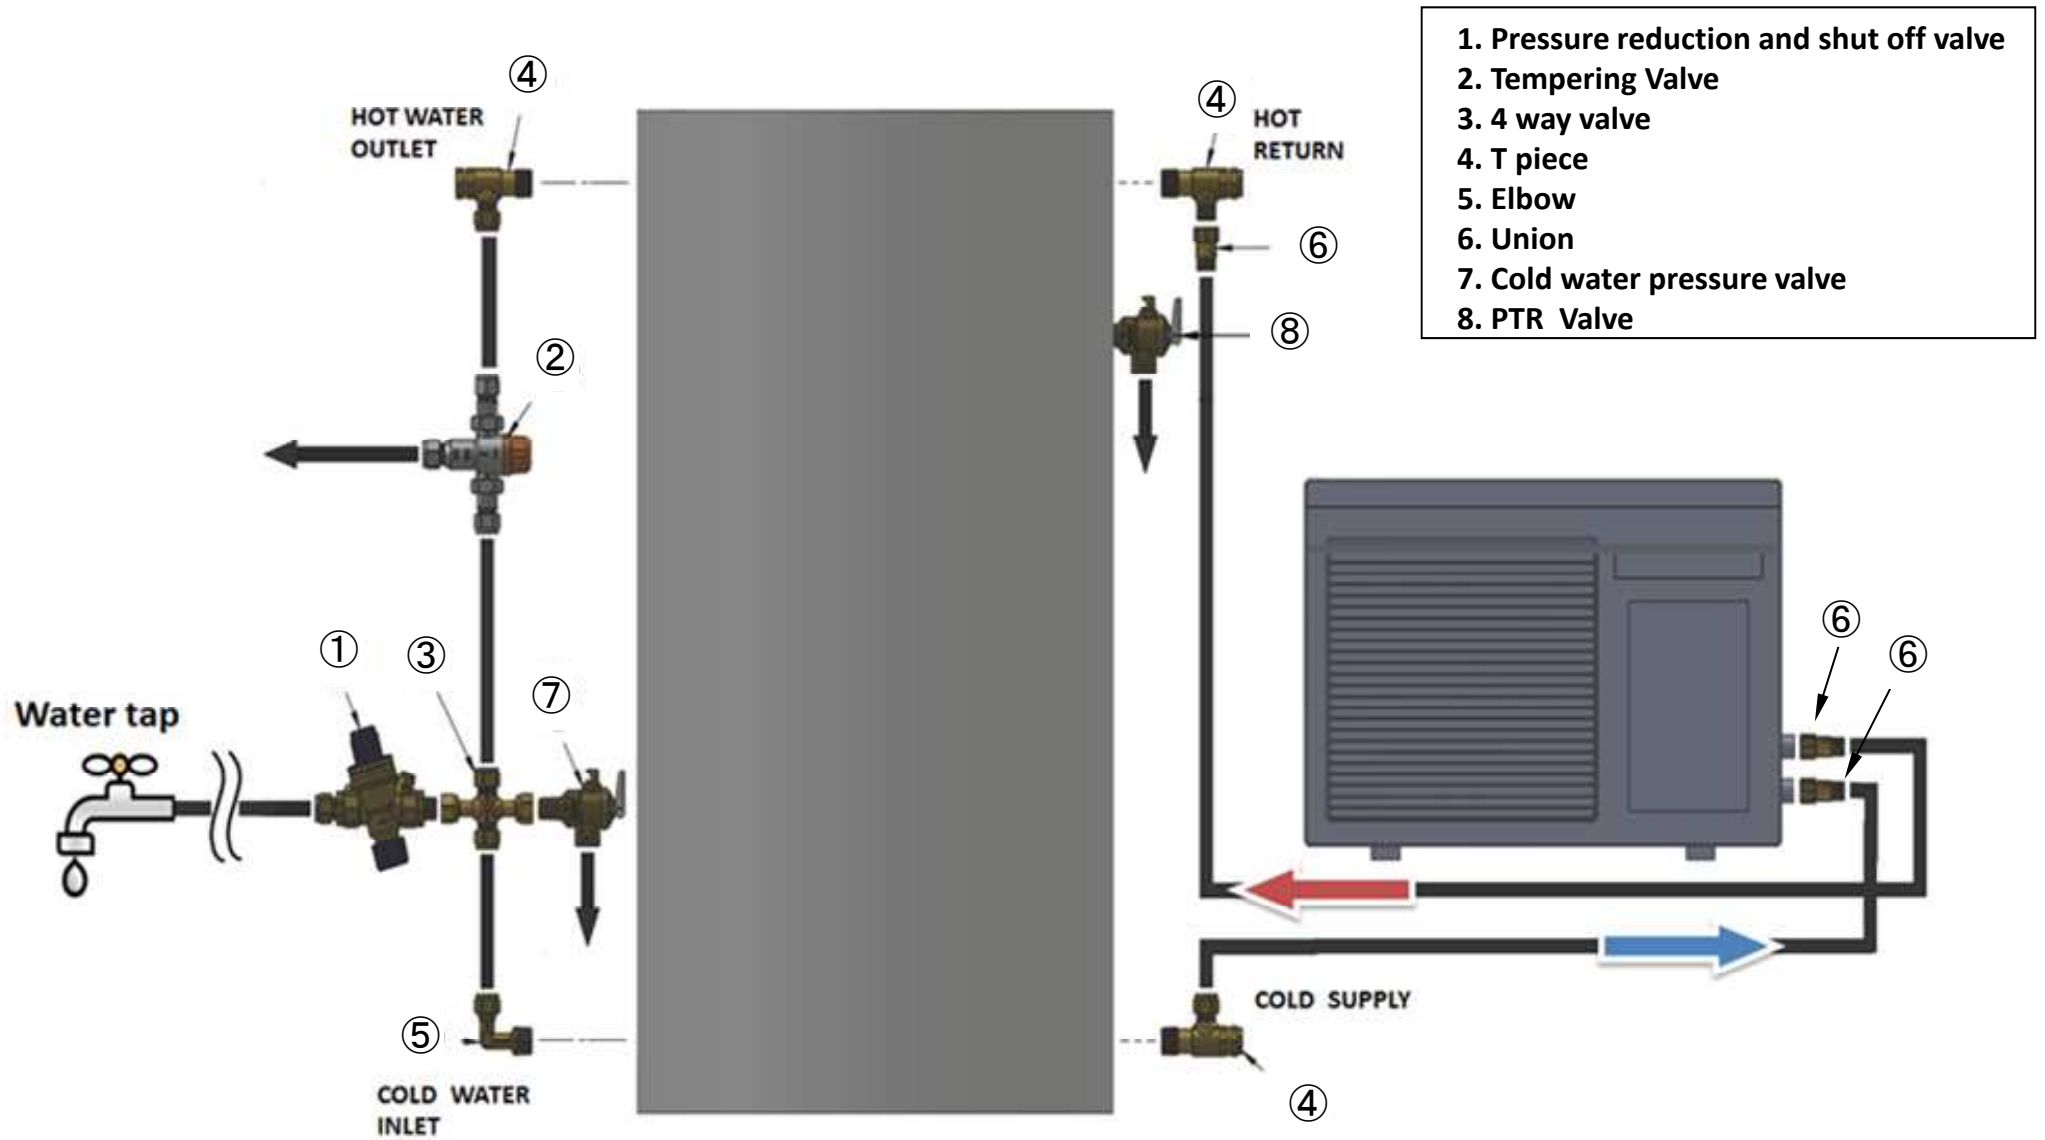

Electrical wire connection

0.5 mm ~ 1 mm

Core Power wire

Black White Green

3 × M4 Screws

Power supply


Ground

Wire holder band

Power line

- Standard tightening torque for the terminal is 1.4 ~ 2.0 N·m.
- Ensure to use a solid wire for the heat pump power communication line and to install the power communication terminal.

Power connection

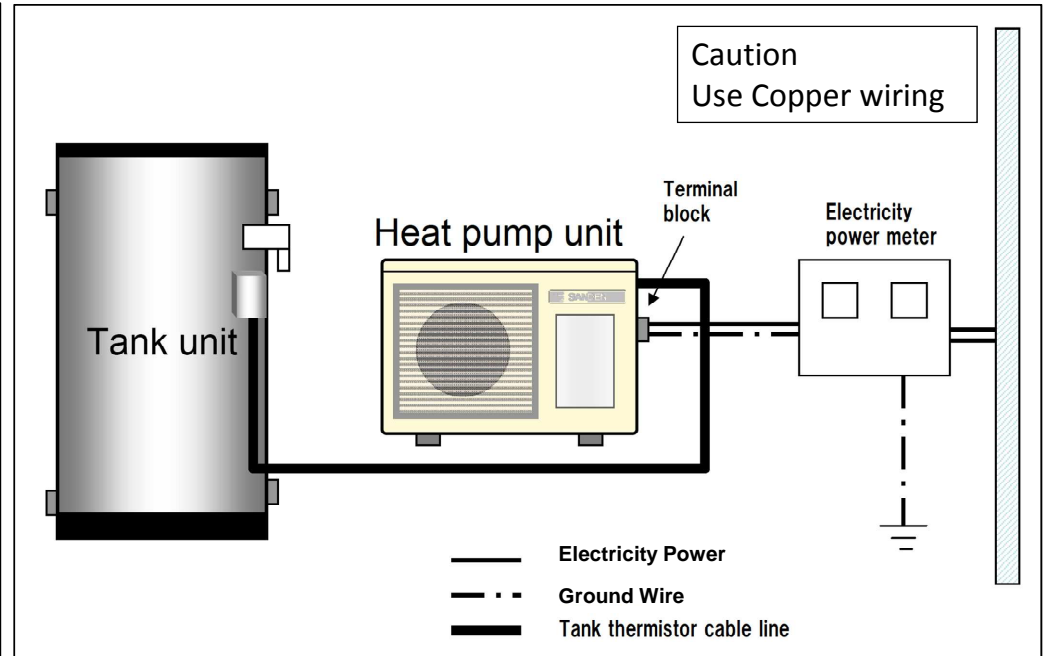

Frozen protection

